

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER




1 PLAN DE SOUS-SOL  
EAU-1 1:350




NOTES:




7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca

ÉCOLE: 884001\_Saint-Johns-2020-EAU  
PROJET: PLOMB DANS L'EAU POTABLE  
DATE: 2020-12-17  
DESSINÉ PAR: Homero.Cabrera



LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
<b>***</b>	SAMPLING CODE
<b>NTU</b>	NOT TO BE USED FOR DRINKING WATER

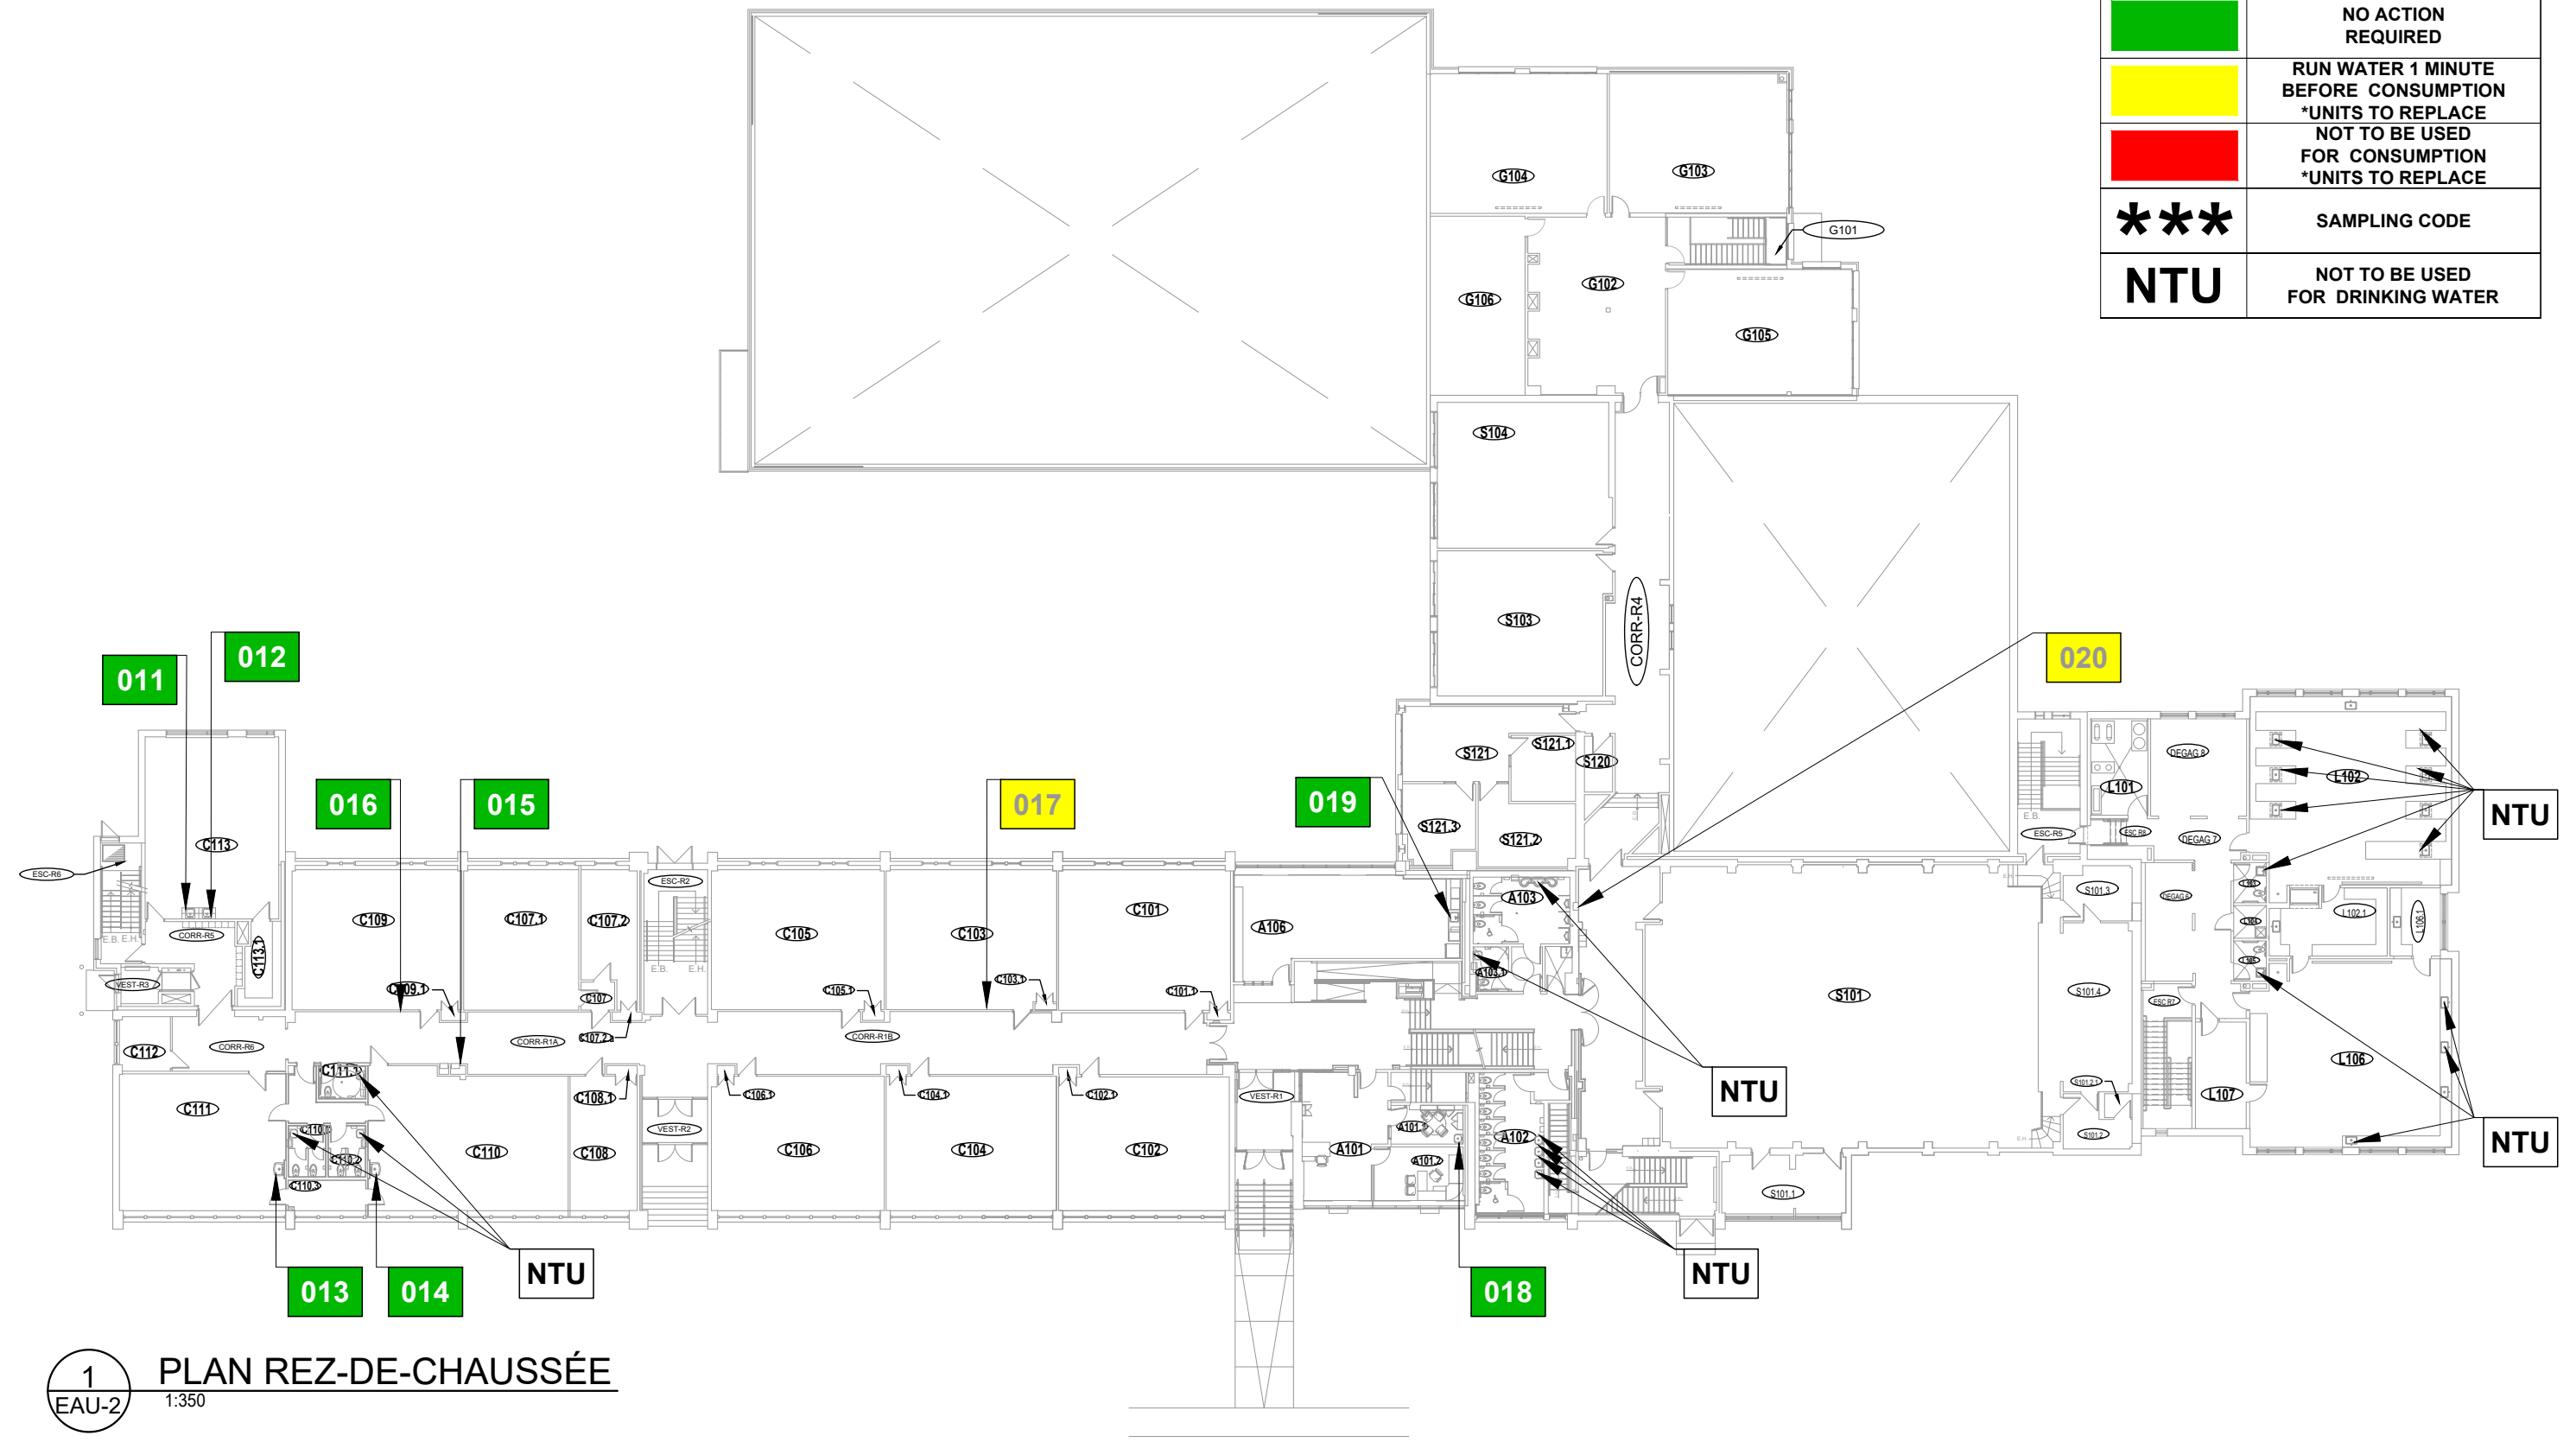

1 PLAN REZ-DE-CHAUSSÉE  
EAU-2 1:350




NOTES:




7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca

ÉCOLE:	884001_Saint-Johns-2020-EAU
PROJET:	PLOMB DANS L'EAU POTABLE
DATE:	2020-12-17
DESSINÉ PAR:	Homero.Cabrera

**EAU-2**

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

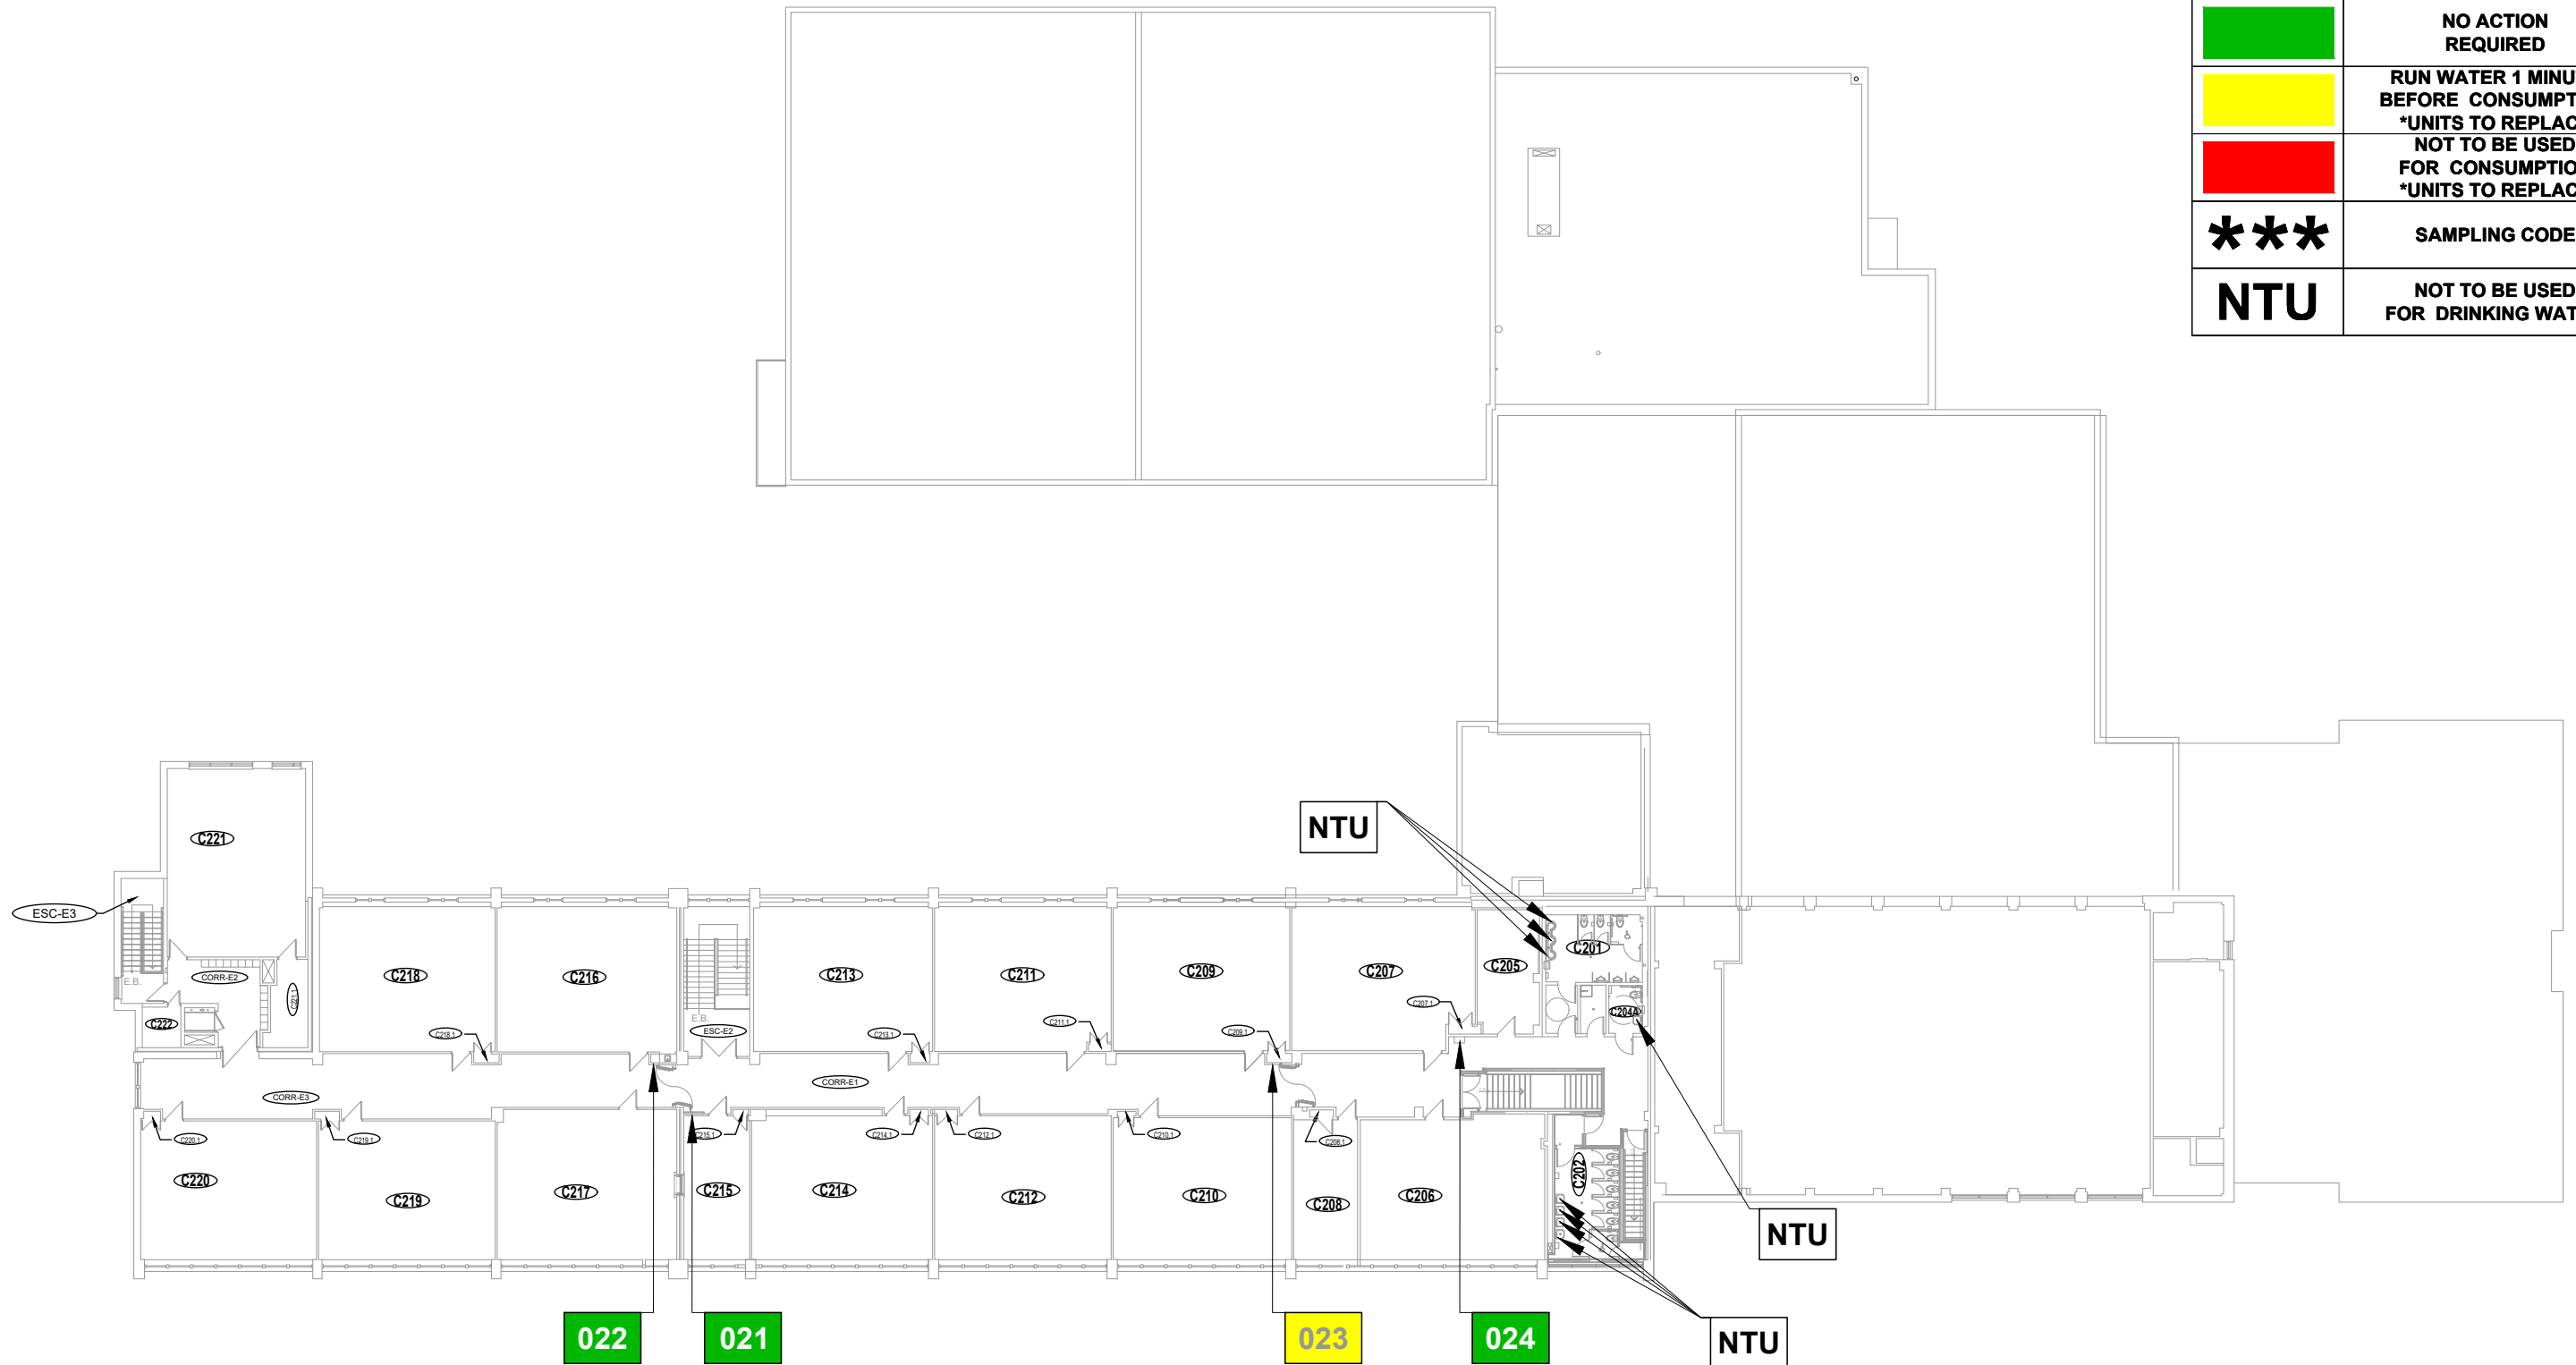

1 PLAN DE L'ÉTAGE  
EAU-3 1:350

NOTES:



7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca

ÉCOLE: 884001\_Saint-Johns-2020-EAU  
PROJET: PLOMB DANS L'EAU POTABLE  
DATE: 2020-12-17  
DESSINÉ PAR: Homero.Cabrera

EAU-3