

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

1 PLAN SOUS-SOL  
EAU-1 1:300

NOTES:



7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca


ÉCOLE: 884005\_Saint-Jude-2020-EAU

PROJET: PLOMB DANS L'EAU POTABLE

DATE: 2020-12-17

DESSINÉ PAR: Homero.Cabrera

EAU-1

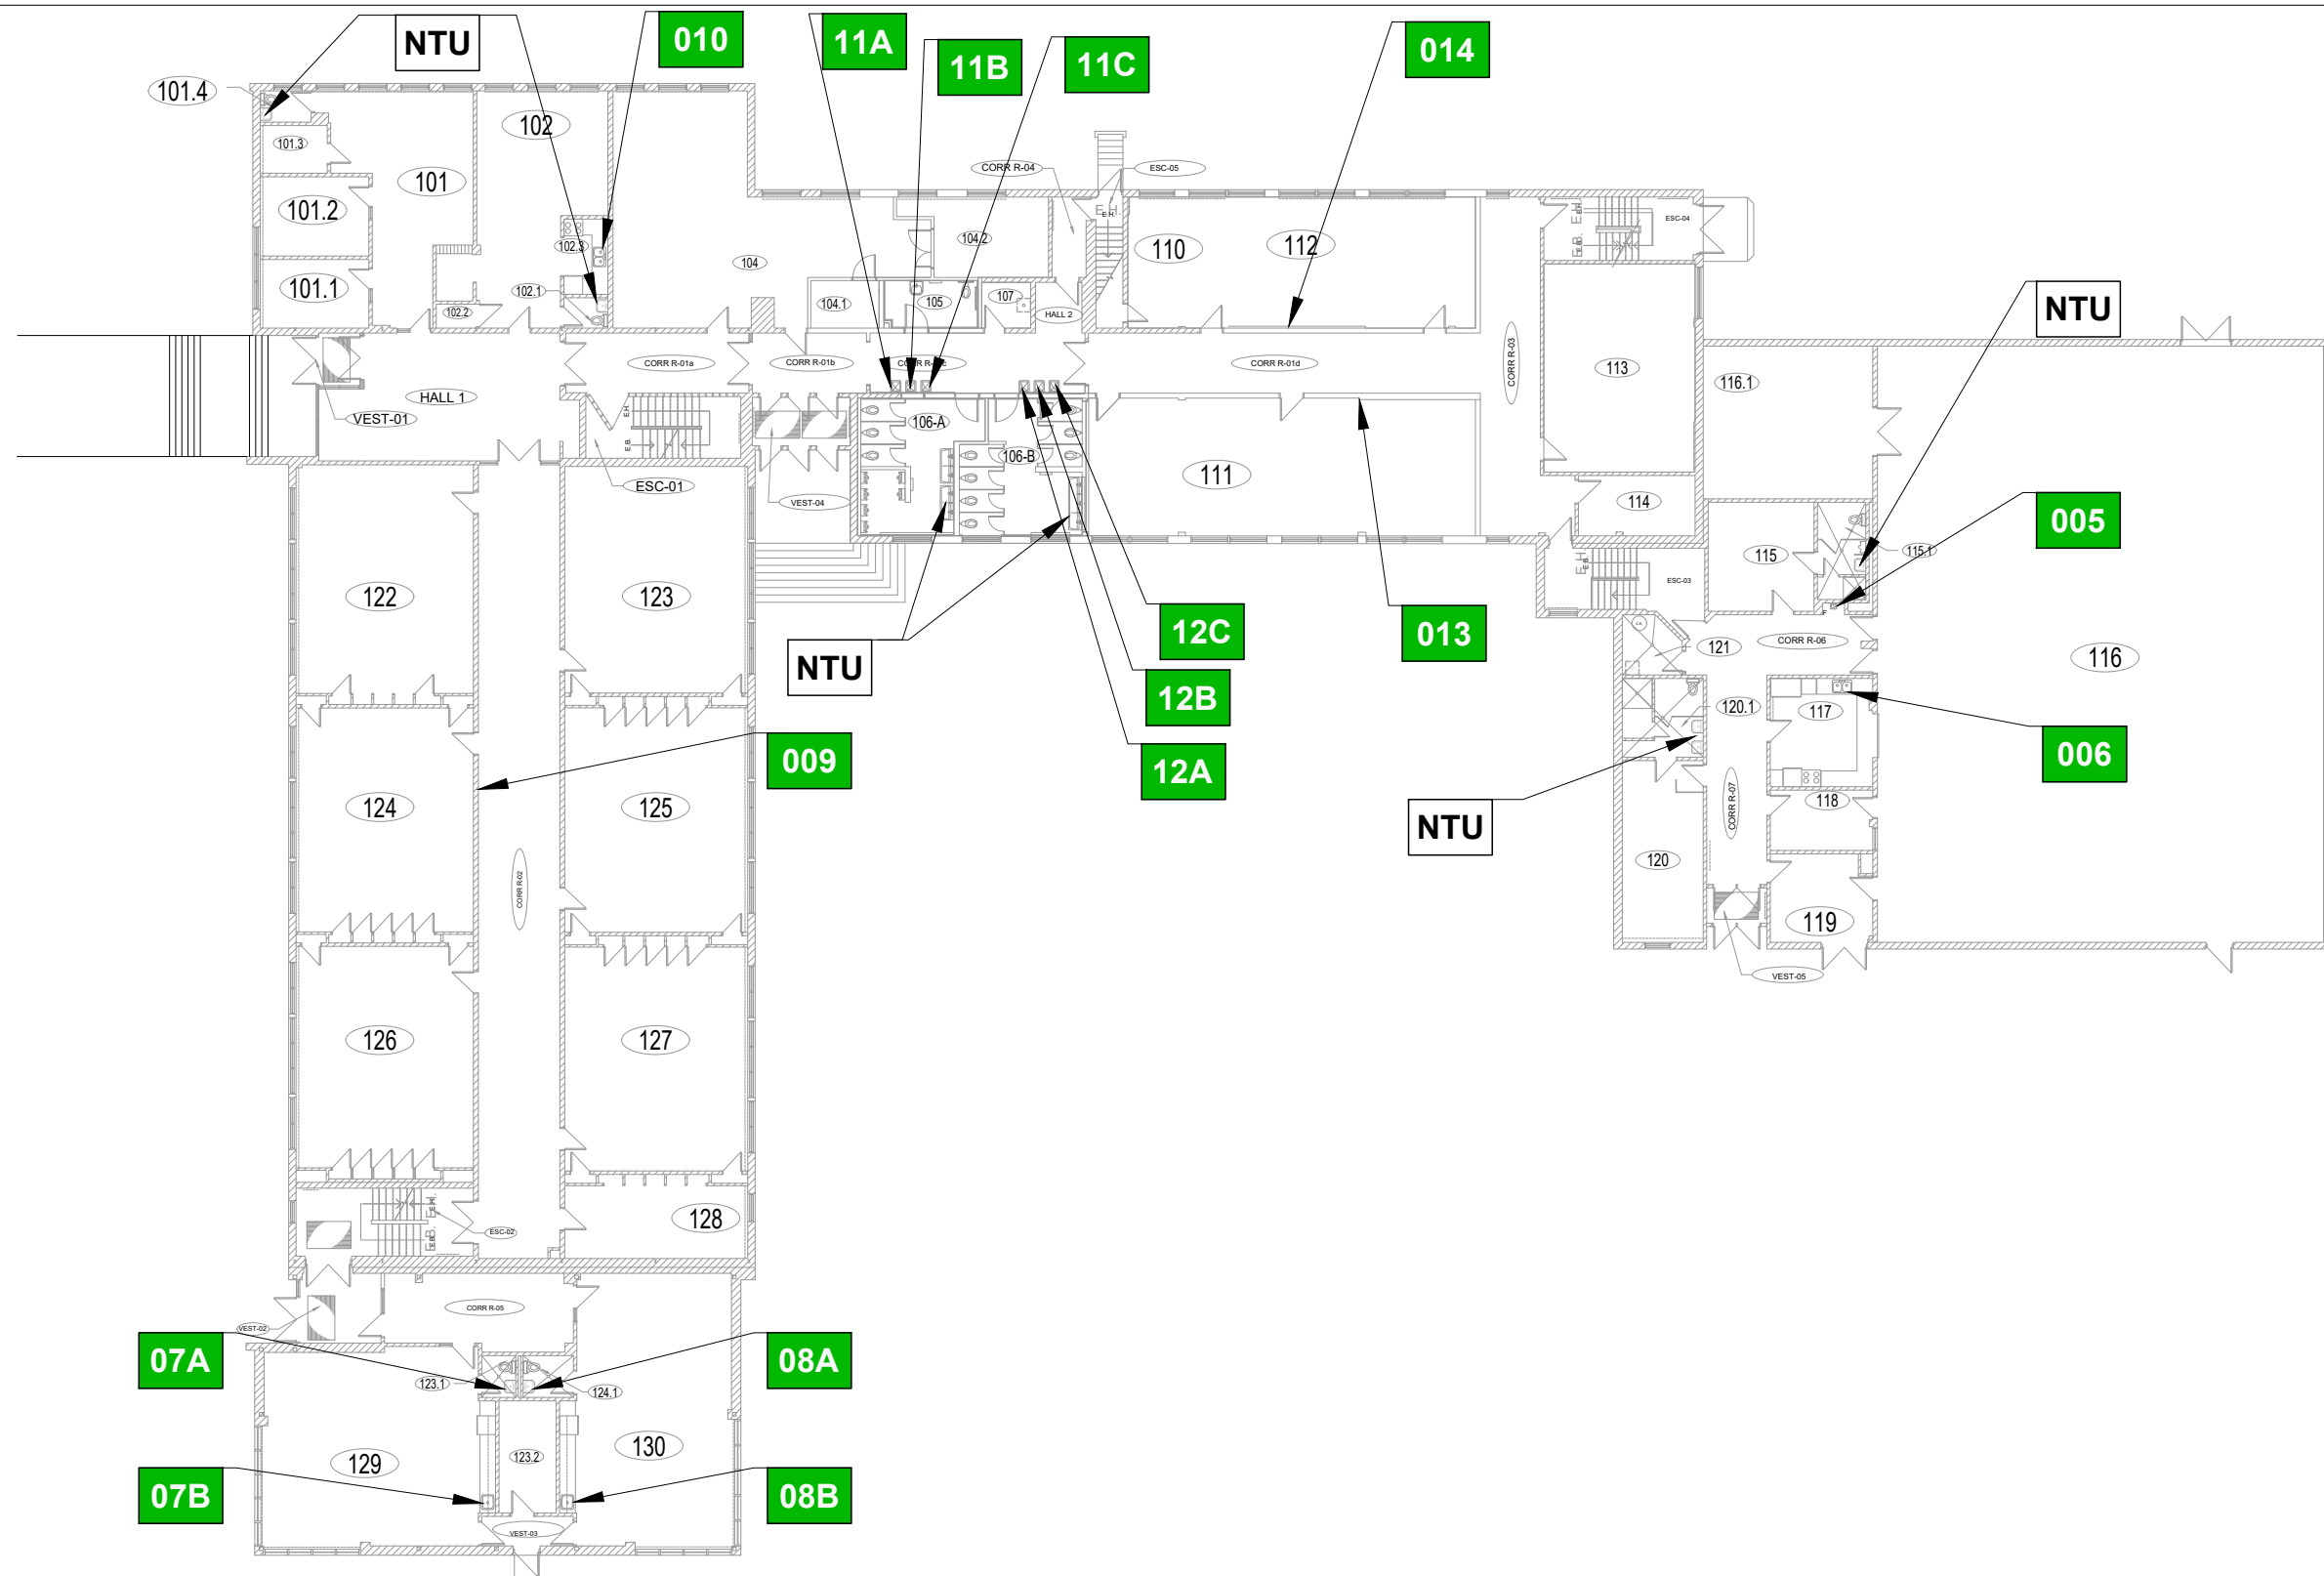

LEGEND	RESULTS LEAD WATER SAMPLING
<span style="background-color: green; color: black;"> </span>	NO ACTION REQUIRED
<span style="background-color: yellow; color: black;"> </span>	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
<span style="background-color: red; color: black;"> </span>	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

1 PLAN REZ-DE-CHAUSSÉE  
EAU-2 1:300


NOTES:



7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca

ÉCOLE: 884005\_Saint-Jude-2020-EAU  
PROJET: PLOMB DANS L'EAU POTABLE  
DATE: 2020-12-17  
DESSINÉ PAR: Homero.Cabrera

EAU-2

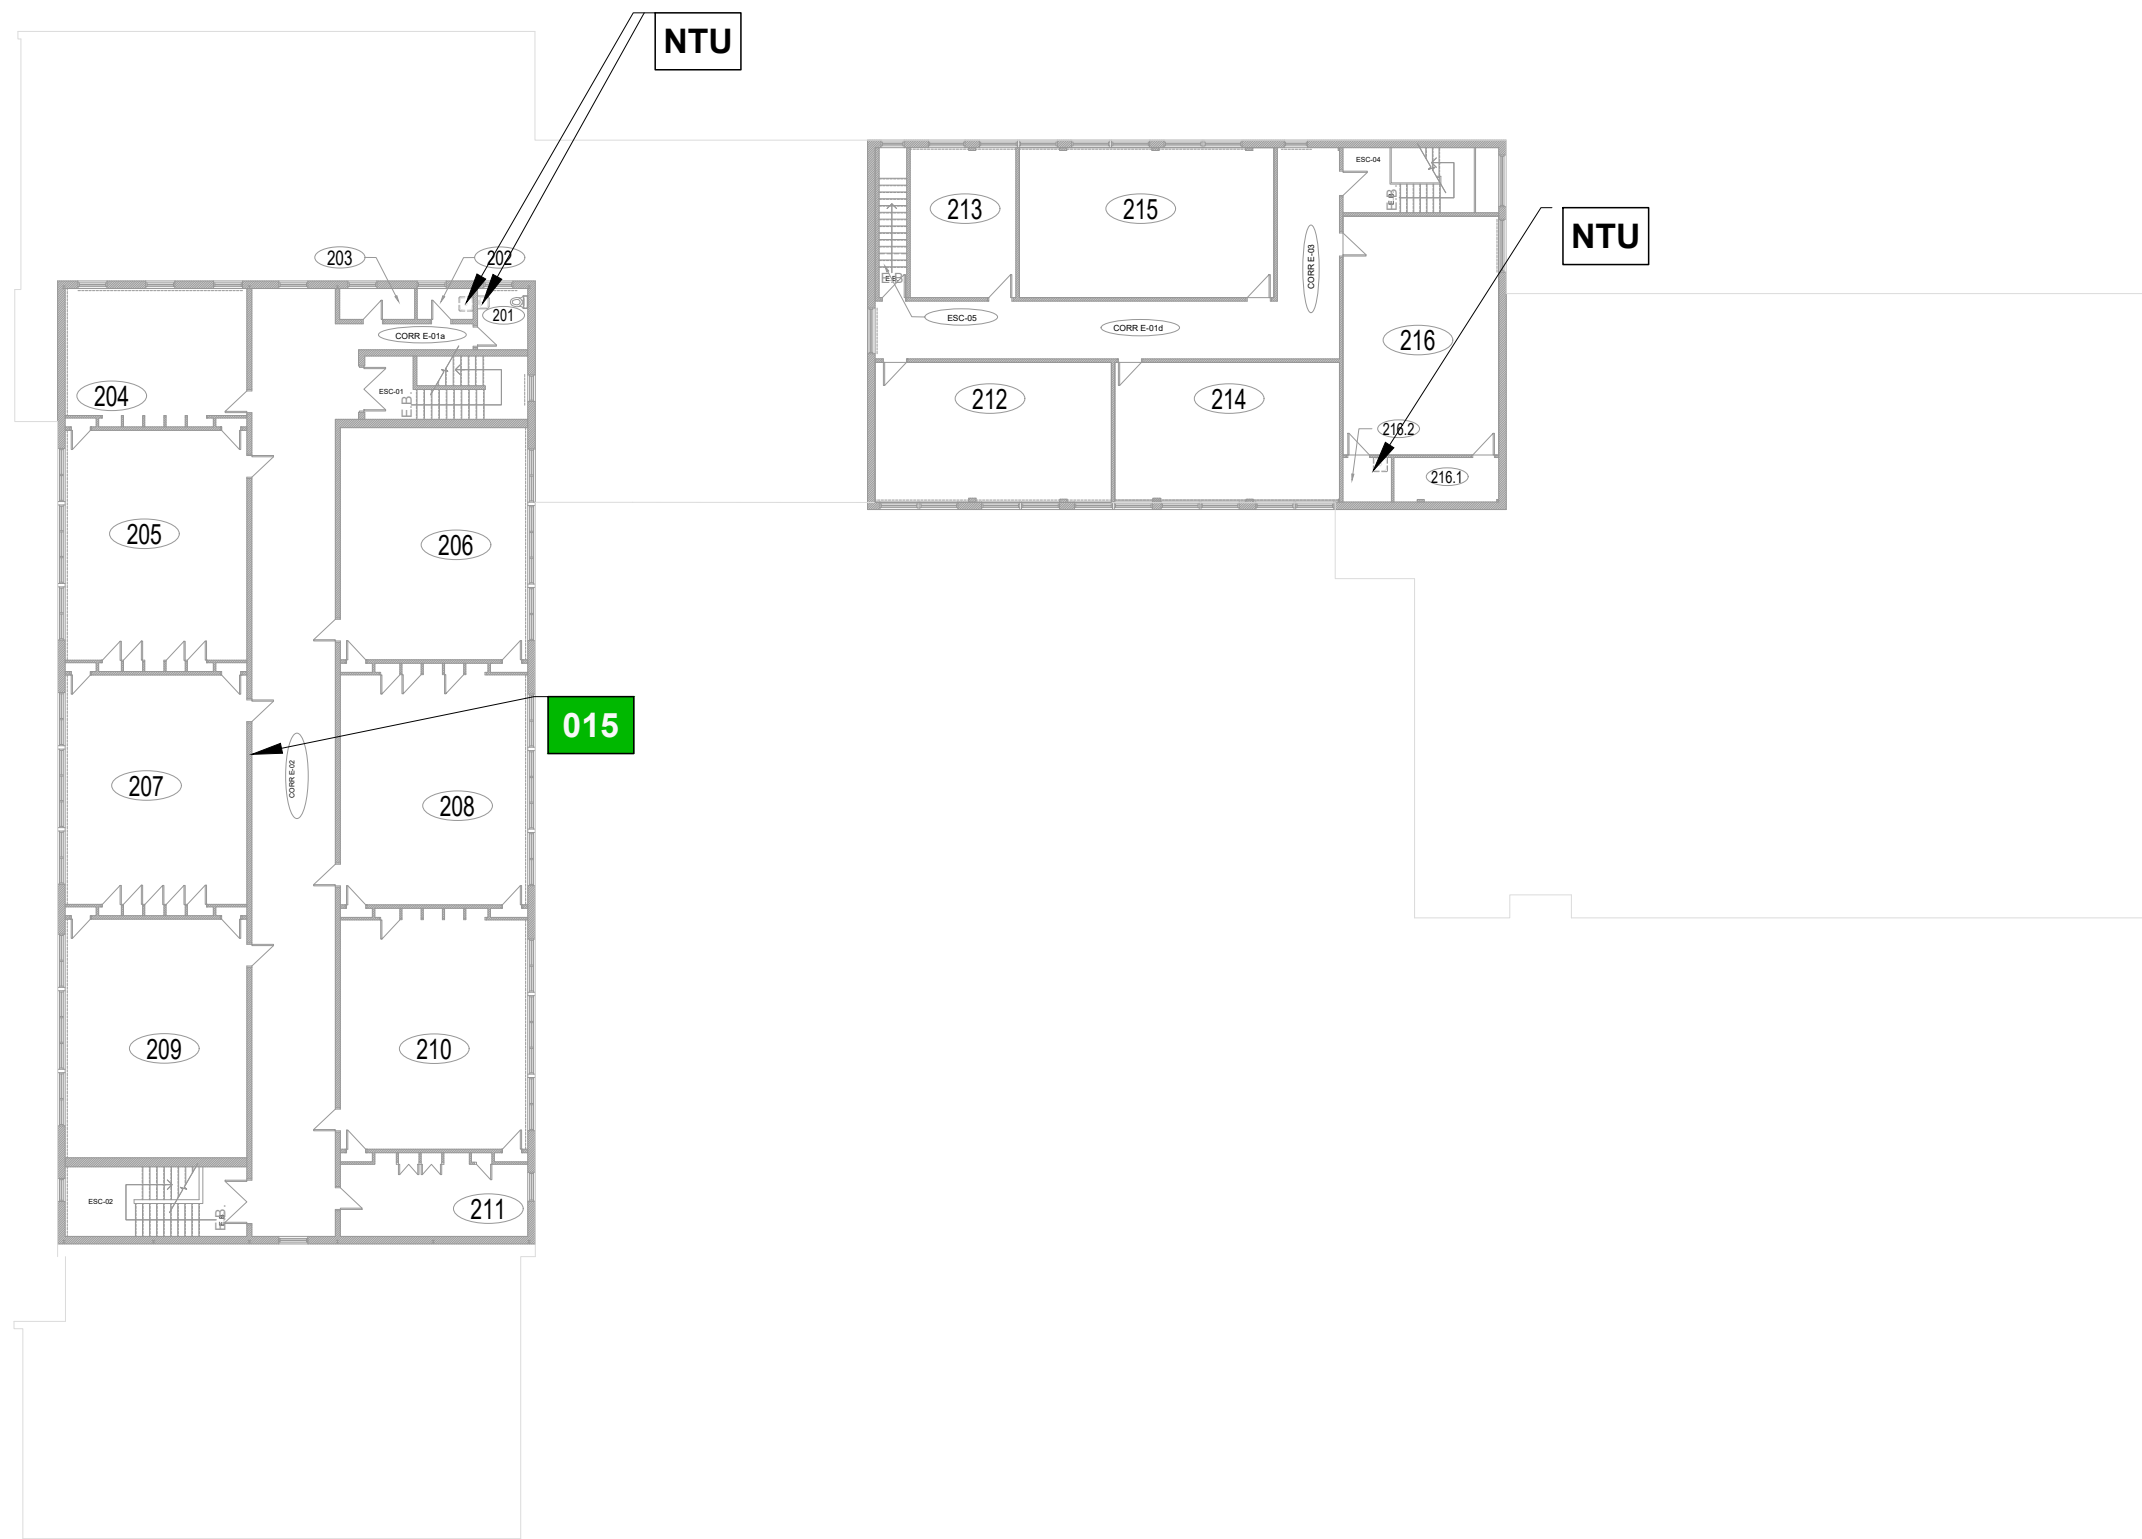

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

1 PLAN L'ÉTAGE  
EAU-3 1:300

NOTES:



7525, CHEMIN DE CHAMBLY  
SAINT-HUBERT, QUÉBEC J3Y 0N7  
TÉL.: 450-672-4010  
TÉLÉC.: 450-465-8809  
COURRIEL: rsb@rsb.qc.ca  
WEB: www.rsb.qc.ca

ÉCOLE: 884005\_Saint-Jude-2020-EAU  
PROJET: PLOMB DANS L'EAU POTABLE  
DATE: 2020-12-17  
DESSINÉ PAR: Homero.Cabrera

EAU-3