

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER


1 PLAN DE SOUS-SOL
EAU-1 1:250


NOTES:



7525, CHEMIN DE CHAMBLY
SAINT-HUBERT, QUÉBEC J3Y 0N7
TÉL.: 450-672-4010
TÉLÉC.: 450-465-8809
COURRIEL: rsb@rsb.qc.ca
WEB: www.rsb.qc.ca

ÉCOLE:884030_ Saint-Lambert Elementary-2020-EAU
PROJET: PLOMB DANS L'EAU POTABLE
DATE: 2020-12-17
DESSINÉ PAR: Homero.Cabrera



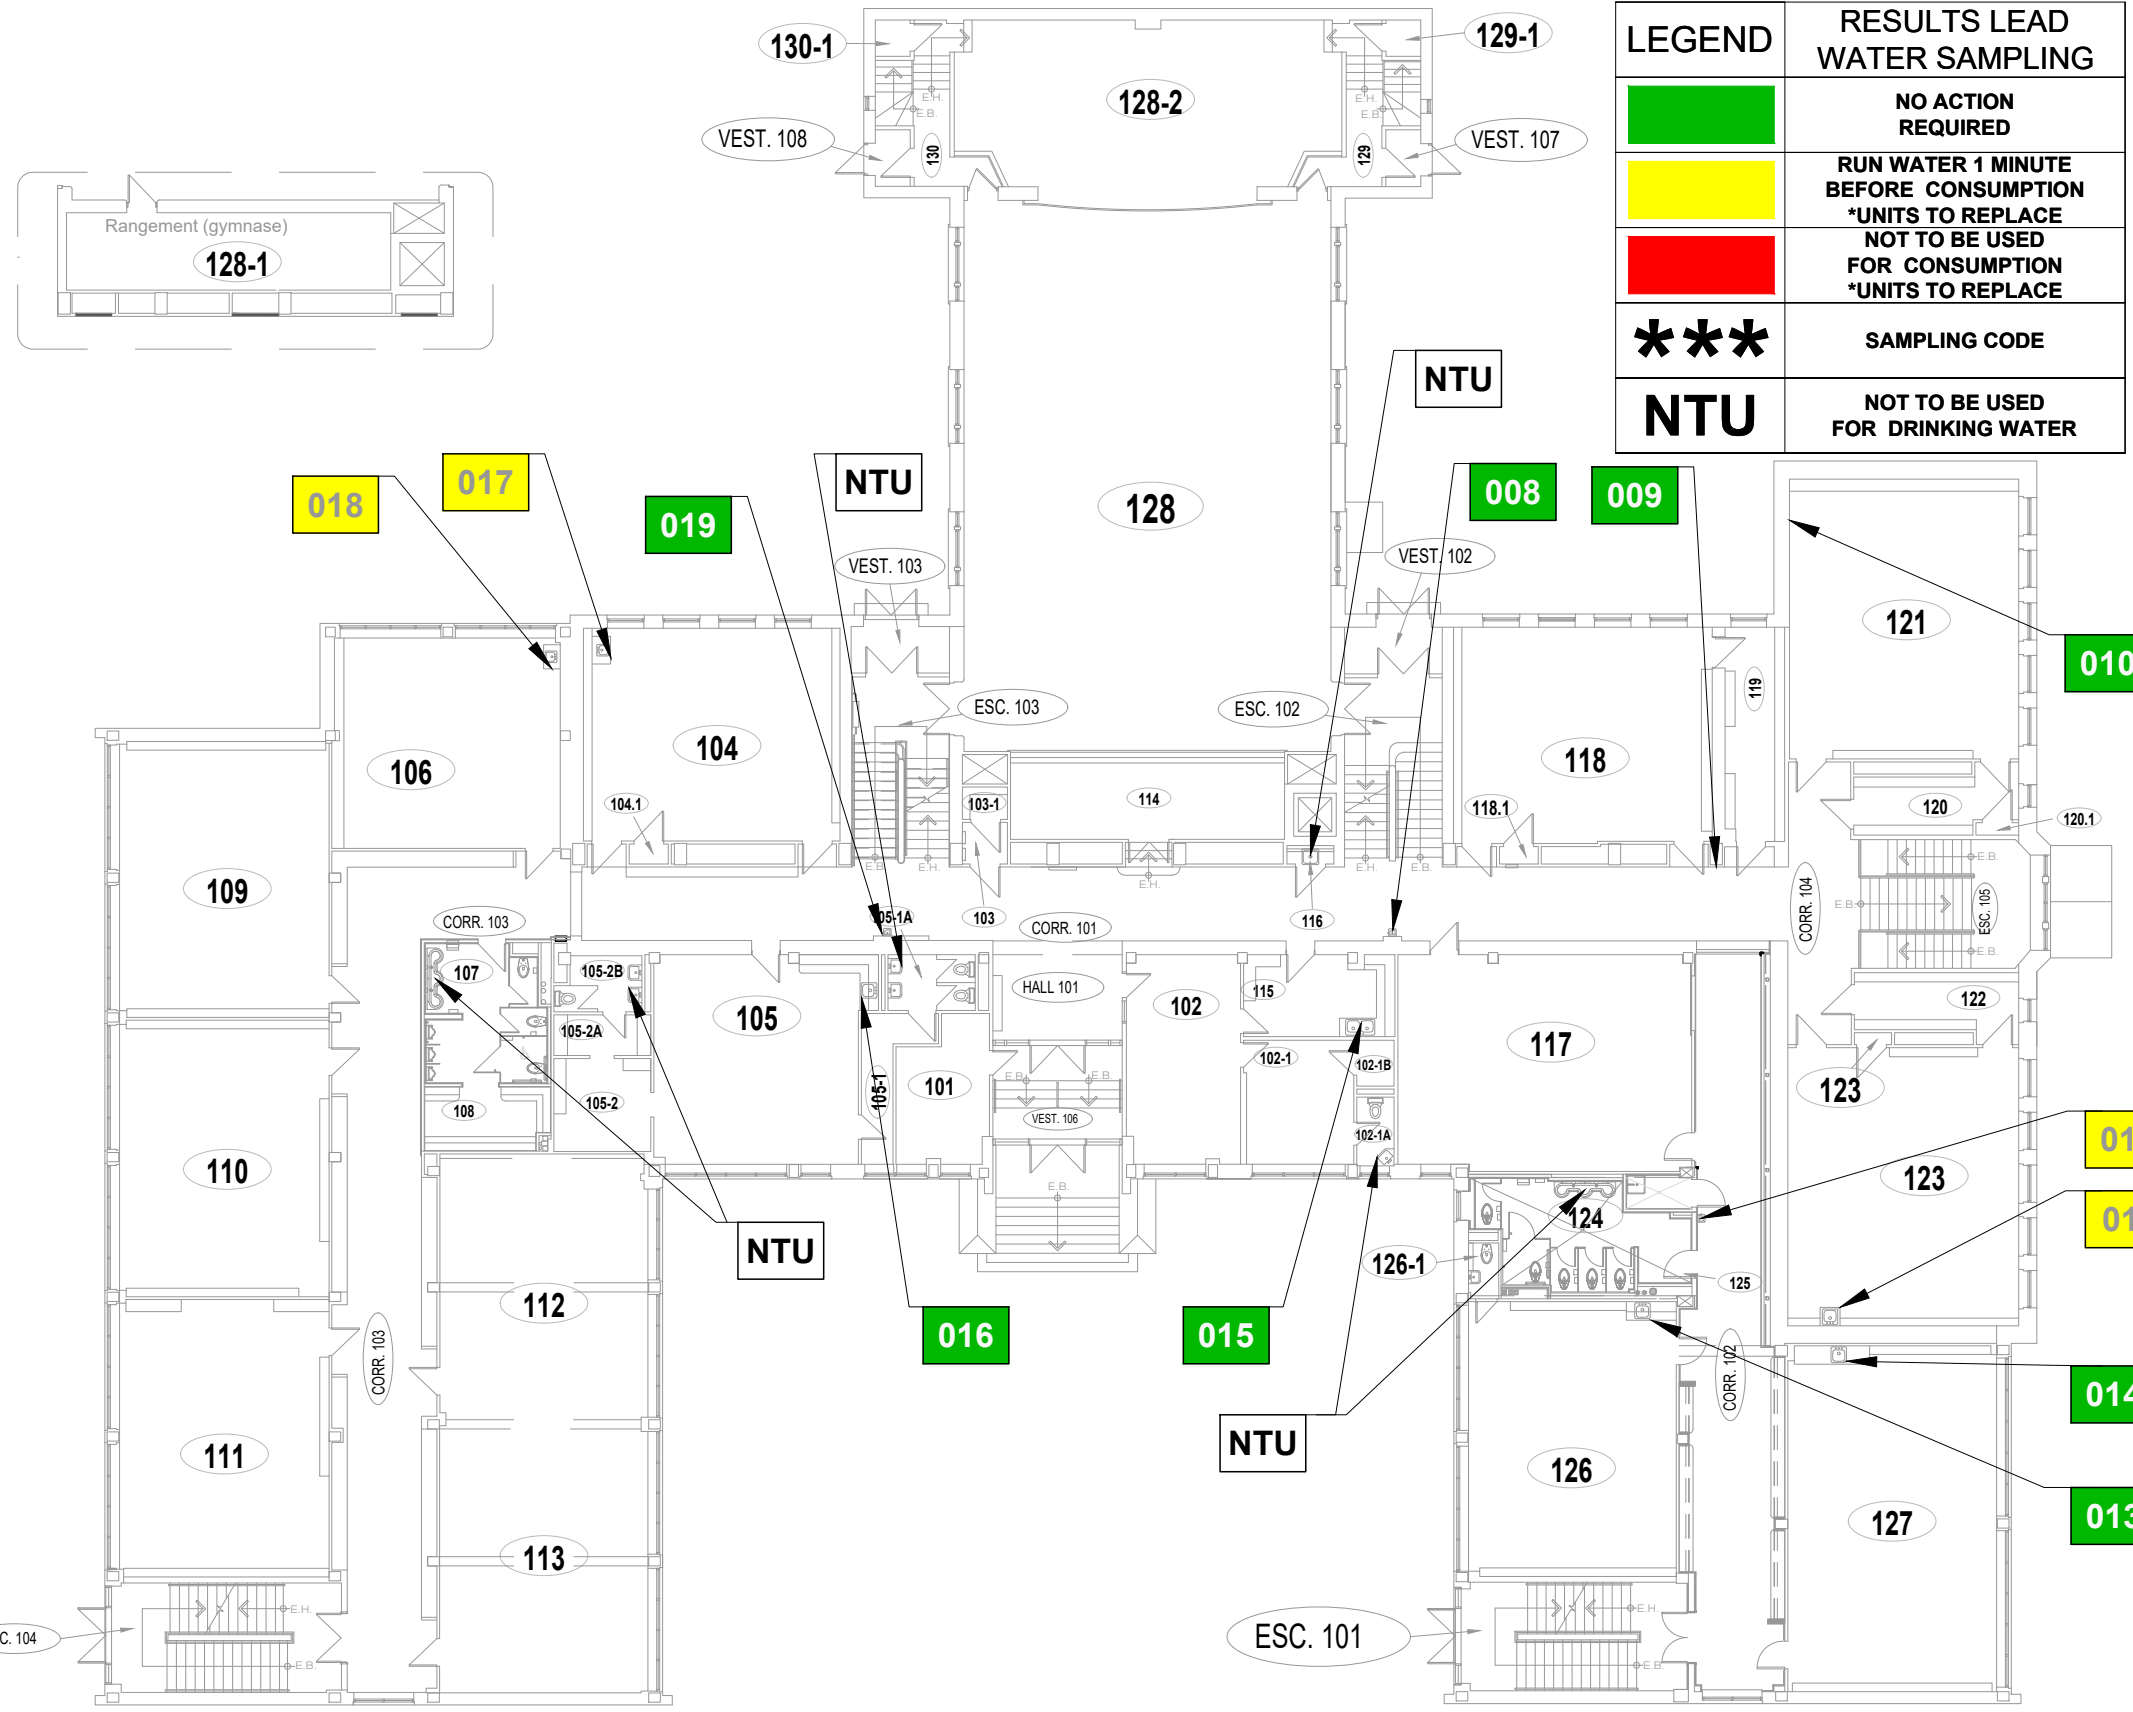

LEGEND	RESULTS LEAD WATER SAMPLING
 	NO ACTION REQUIRED
 	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
 	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

1 PLAN R-D-CH
EAU-2 1:250




NOTES:




7525, CHEMIN DE CHAMBLY
SAINT-HUBERT, QUÉBEC J3Y 0N7
TÉL.: 450-672-4010
TÉLÉC.: 450-465-8809
COURRIEL: rsb@rsb.qc.ca
WEB: www.rsb.qc.ca

ÉCOLE: 884030_ Saint-Lambert Elementary-2020-EAU
PROJET: PLOMB DANS L'EAU POTABLE
DATE: 2020-12-17
DESSINÉ PAR: Homero.Cabrera

EAU-2

LEGEND	RESULTS LEAD WATER SAMPLING
	NO ACTION REQUIRED
	RUN WATER 1 MINUTE BEFORE CONSUMPTION *UNITS TO REPLACE
	NOT TO BE USED FOR CONSUMPTION *UNITS TO REPLACE
***	SAMPLING CODE
NTU	NOT TO BE USED FOR DRINKING WATER

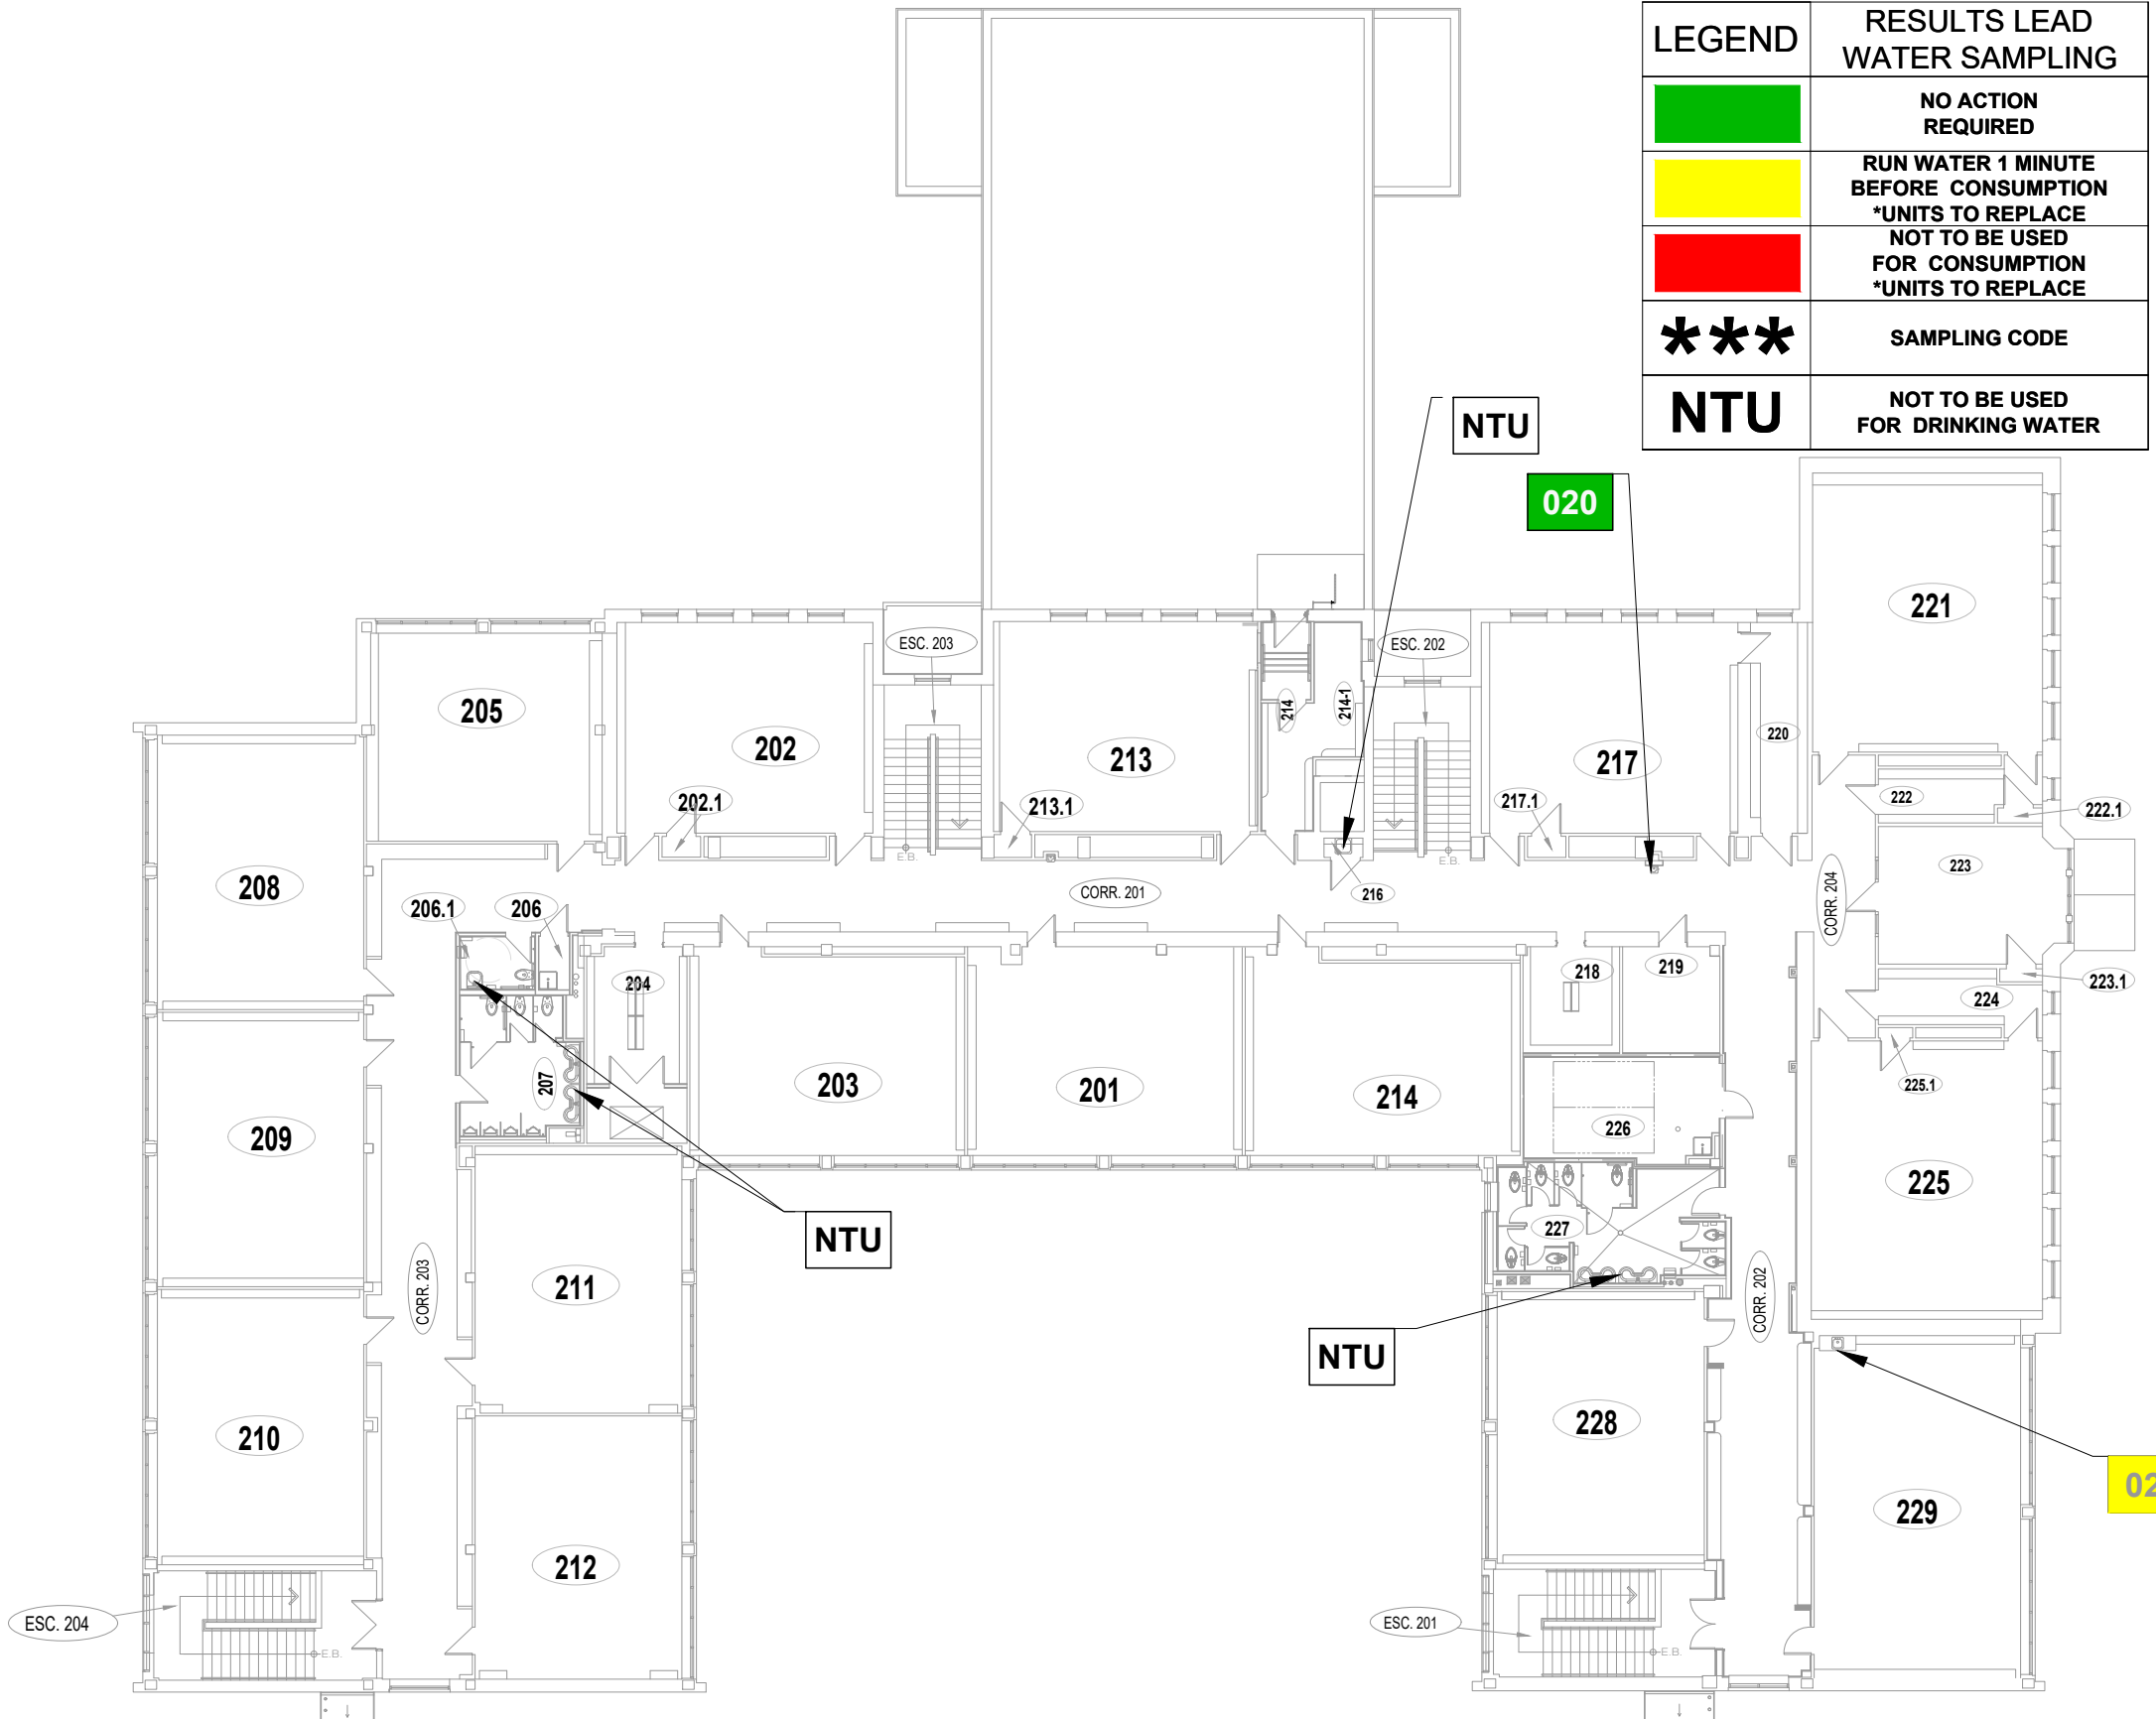

1 PLAN DE L'ÉTAGE
EAU-3 1:250

NOTES:



7525, CHEMIN DE CHAMBLY
SAINT-HUBERT, QUÉBEC J3Y 0N7
TÉL.: 450-672-4010
TÉLÉC.: 450-465-8809
COURRIEL: rsb@rsb.qc.ca
WEB: www.rsb.qc.ca

ÉCOLE: 884030_ Saint-Lambert Elementary-2020-EAU
PROJET: PLOMB DANS L'EAU POTABLE
DATE: 2020-12-17
DESSINÉ PAR: Homero.Cabrera

EAU-3